

# EPA Emission Standards for DIESEL GENERATORS

AUTHOR  
**BRAD MEISSNER**  
Product Manager

KOHLER Co.  
Power Systems Division

## INTRODUCTION:

The U.S. Environmental Protection Agency (EPA) is responsible for implementing and enforcing federal regulations for pollutant emissions produced by on-highway and off-road engines.

The focus of the EPA is to reduce the six common pollutants: ozone, particulate matter, carbon monoxide, nitrogen oxides, sulfur dioxide, and lead. They do so by implementing a set of standards to reach increasingly stringent emissions levels in the United States.

This paper provides an overview of the three primary EPA regulations affecting generator set use in the United States.

## EPA DIESEL ENGINE EMISSION TERMINOLOGY:

### CERTIFICATION TYPE

**Certified Engine** – new diesel engines introduced into commerce in the U. S. must be certified by the EPA for the intended use of the engine. Engine certifications are typically performed by the engine manufacturer. The process includes testing to ensure the engines meet the applicable regulations and continued testing to ensure they meet the regulations during their useful life. The EPA issues a Certificate of Conformity (CoC) to signify the engine has been tested and certified.

**Compliant Engine** – an engine that meets a given EPA regulation emission requirement but has not been certified by the EPA to meet those levels. Compliant solutions are often used to meet local requirements that have lower emissions requirements than the EPA federal regulation requirements.

### USE TYPE

**Emergency** – defined by EPA subpart ZZZZ as meeting the following operating requirements:

- Unlimited use for emergencies (e.g., power outage, fire, flood)
- Emergency engines may operate for 100 hr/yr for maintenance/testing
- 50 hr/yr of the 100 hr/yr allocation can be used for:
  - Nonemergency situations if no financial arrangement
  - Local reliability as part of a financial arrangement with another entity if specific criteria met (*existing RICE at area sources of HAP only*)

**Nonemergency** – those engines that do not qualify as emergency use only.

*Note: The EPA does not regulate a generator set and therefore does not recognize the generator rating as an indication of use. ISO-8528 ratings are often talked about in conjunction with required emissions compliance level. It does not violate any regulations to have an emergency use generator with a Prime or Continuous rating.*

**LOCATION**

**Stationary** – off-highway engine permanently mounted in a single location. Also, a movable non-road engine is classified as stationary if it stays in one location for more than 12 months.

**Nonroad** – engines used on nonhighway equipment meant to be movable; either by being propelled, such as a skidloader, or by transport, such as a mobile/towable generator.

**SITE CLASSIFICATION**

The site classification pertains to the entire facility or contiguous complex where the engine is located. There are two different site classifications.

**Major Source** – any stationary source that emits 10 tons per year or more of any one hazardous air pollutant or 25 tons/year or more of any combination of hazardous air pollutants.

**Area Sources** – sources that are not major sources.

**ISO-8528 GENERATOR RATINGS**

**Standby** – a standby generator is typically specified for generators with stationary emergency engines.

**Prime** – a prime rating is typically specified for generators with stationary nonemergency engines or nonroad engines for mobile applications.

**RICE NESHAP:**

**TERMINOLOGY AND DEFINITION**

Title 40, part 63, subpart ZZZZ (63.6580) of the Code of Federal Regulations (CFR) covers the National Emission Standards for Hazardous Air

Pollutants (NESHAP) for reciprocating internal combustion engines (RICE).

The regulation applies to both existing and new engines. However, new engines required to meet New Source Performance Standards (NSPS), such as a combustion ignition (CI) engine, are compliant with RICE NESHAP, and no further requirements apply. Therefore, RICE NESHAP is a primary consideration of engines built prior to model year 2007.

It is the responsibility of the engine owner to review and comply with RICE NESHAP for an existing engine.

**NESHAP FOCUS**

The intent of the regulation is to reduce pollutants from nonregulated nonemergency use-type engines. Emergency engines are excluded.

The EPA has determined that carbon monoxide (CO) is the most effective indicator of the pollutants. Therefore, the regulation seeks a percent reduction of measured CO from the engine.

The applicability and compliance criteria are determined by site classification and size of the engine determined by horsepower rating. The table in *Figure 1* below provides an overview of the percent of CO reduction required to bring an affected engine into compliance.

A combustion ignition engine would typically require a field added diesel oxidation catalyst (DOC) to become compliant.

*Figure 1*

CO Reduction – NESHAP for Stationary Diesel (CI) Engines

| Area Sources                |              |     |
|-----------------------------|--------------|-----|
| Nonemergency 300 < hp ≤ 500 | 49 ppmvd CO  | 70% |
| Nonemergency > 500 hp       | 23 ppmvd CO  | 70% |
| Major Sources               |              |     |
| Nonemergency 100 ≤ hp ≤ 300 | 230 ppmvd CO |     |
| Nonemergency 300 < hp ≤ 500 | 49 ppmvd CO  | 70% |
| Nonemergency > 500 hp       | 23 ppmvd CO  | 70% |

### NONROAD DIESEL ENGINES


Title 40, part 1039, formerly 89, of the Code of Federal Regulations (CFR) covers the EPA emission standards for nonroad diesel engines. The standard is applicable to a wide range of construction, agricultural, and industrial equipment.

Diesel generators mounted on either a trailer or a skid meant for transport must abide by nonroad diesel emission regulations, not the stationary emissions discussed later in this paper. The standard classifies stationary engines by brake horsepower and use type.

Depending on the classification of the engine, it must be below or at levels of emissions for nitrogen oxides (NO<sub>x</sub>), particulate matter (PM), carbon monoxide (CO), and hydrocarbons (HC).

The standards for nonroad diesel engines were first introduced in 1994. Multiple iterations were made to enforce increasingly stringent regulations. This phased approach has taken on an industry designation as Tiers. The initial Tiers 1-3, phased in by 2008, were met by advanced engine design to limit the creation of the pollutants. See *Figure 2*.

Figure 2

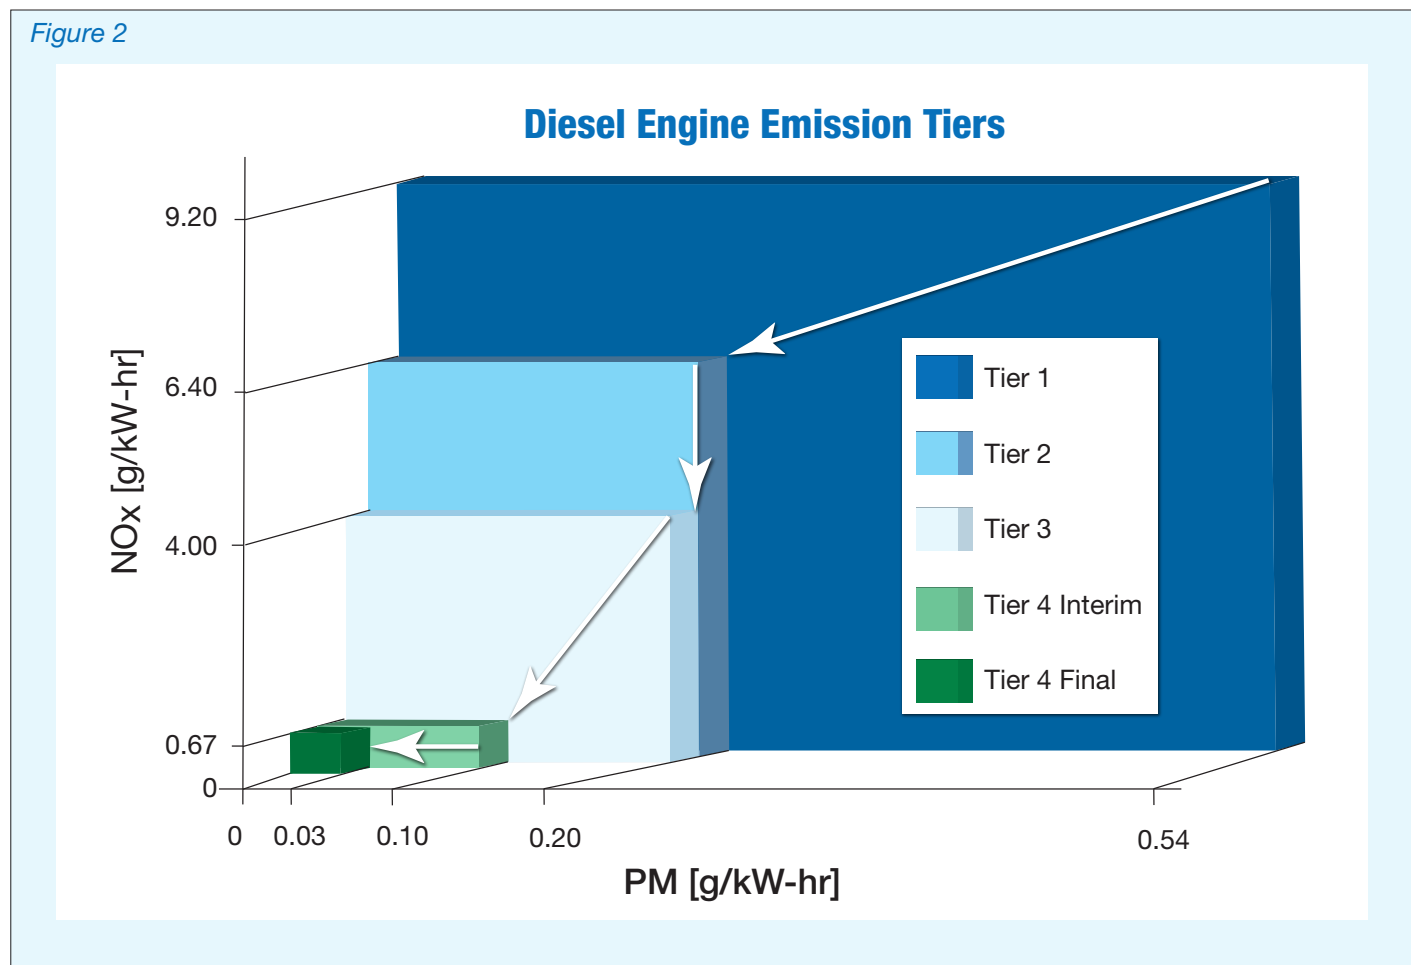


### TIER 4 REGULATIONS

The latest Tier 4 regulation was announced in 2004 with a phase-in period from 2008-2015 to allow engine and equipment manufacturers time to prepare products to meet the stringent requirements. See *Figure 3*.

Tier 4 regulations require the NOx and PM levels of diesel engines to be reduced upwards of 90 percent from previous Tiers. To achieve such levels exhaust aftertreatment systems are required.

The primary reason is NOx and PM formation has an inverse relationship. PM forms from partial combustion of diesel fuel in cooler parts of the cylinder. NOx is the result of high cylinder temperatures oxidizing some of the nitrogen from the air.

The trade-off, unfortunately, is an inverse relationship when it comes to in-cylinder engine management for performance and emissions. See *Figure 4*.

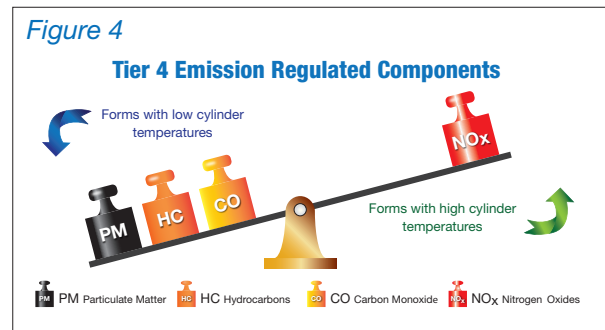

*Figure 3* Phase-In Program for Nonroad Engines

| Year                          | 2008   | 2009 | 2010    | 2011                                    | 2012                            | 2013   | 2014   | 2015 |   |
|-------------------------------|--|------|---------|---|---------------------------------|--|--|------|---|
| kW <8                         | 0.40/7.5/8.0 (Table 1 1039.102 & Table 1 1039.101) |      |         |   |                                 |  |  |      |   |
| 8 ≤ kW ≤ 19                   | 0.40/7.5/6.6 (Table 1 1039.102 & Table 1 1039.101) |      |         |   |                                 |  |  |      |   |
| 19 ≤ kW ≤ 37                  | 0.30/7.5/5.5 (Table 2 1039.102)                    |      |         |   |                                 | 0.03/4.5/5.5 (Table 2 1039.102 & Table 1 1039.101) |  |      |   |
| 37 ≤ kW ≤ 56                  | 0.30/4.7/5.0 (Table 3 1039.102)                    |      |         |   |                                 | 0.03/4.7/5.0 (Table 3 1039.102 & Table 1 1039.101) |  |      |   |
| 56 ≤ kW ≤ 75                  |  |      |         |   | 0.02/4.7/5.0 (Table 4 1039.102) |  | 0.02/0.40 + 0.19/5.0 (Table 4 1039.102 & Table 1 1039.101) |      |   |
| 75 ≤ kW ≤ 130                 |  |      |         |   | 0.02/4.0/5.0 (Table 5 1039.102) |  | 0.02/0.40 + 0.19/5.0 (Table 5 1039.102 & Table 1 1039.101) |      |   |
| 130 ≤ kW ≤ 560                |  |      |         | 0.02/4.0/3.5 (Table 6 1039.102)         |                                 |  | 0.02/0.40 + 0.19/3.5 (Table 6 1039.102 & Table 1 1039.101) |      |   |
| 560 ≤ kW ≤ 900                |  |      |         | 0.10/3.5 + 0.40/3.5 (Table 7 1039.102)  |                                 |  |  |      | 0.03/0.67 + 0.19/3.5 (Table 1 1039.101) |
| kW >900                       |  |      |         | 0.10/0.67 + 0.40/3.5 (Table 7 1039.102) |                                 |  |  |      | 0.03/0.67 + 0.19/3.5 (Table 1 1039.101) |
| Chart Legend PM/NOx + NMHC/CO |  |      | Tier 4i |   | Tier 4                          |  |  |      |   |

## NSPS FOR CI STATIONARY ENGINES: NEW SOURCE PERFORMANCE STANDARDS

Title 40, part 60, subpart IIII of the Code of Federal Regulations (CFR) covers the New Source Performance Standards (NSPS) for stationary reciprocating internal combustion engines.

The emissions levels of the various categories are based off emission levels enforced for various types of mobile equipment; therefore, no new engines emission levels were instituted with the ruling. Much of the ruling is based on the content of title 40, part 89, that governs nonroad diesel engines.

The standards were first introduced in 2005 and phased in completely by 2015. The phase-in program for the stationary nonemergency engines can be seen in *Figure 5*.

Engines not capable of this will require the use of multiple aftertreatment devices.

For an explanation of diesel engine exhaust aftertreatment systems refer to Kohler Power Systems white paper: *Diesel Generator Emissions Technologies and Aftertreatment Devices*.




The NSPS regulation has special exemptions for emergency use engines; for instance, a standby generator only meant to operate during power outages or service and maintenance activities. The phase-in program for stationary emergency engines is shown in *Figure 6*.



The highest levels reached were selected to avoid the use of aftertreatment equipment due to the low runtime hours of emergency engines. The environmental and health impacts are negligible from these sources.

The stationary power generation market is

*Figure 5* Phase-In Program for Stationary Nonemergency Engines

| ENGINE GENERATOR |          | 2007 | 2008              | 2009 | 2010 | 2011               | 2012         | 2013         | 2014               | 2015 | 2016 |  |
|------------------|----------|------|-------------------|------|------|--------------------|--------------|--------------|--------------------|------|------|--|
| kWm              | kWe      |      |                   |      |      |                    |              |              |                    |      |      |  |
| 8 -<19           | 10-15    |      | 6.6/7.5/0.40      |      |      |                    |              |              |                    |      |      |  |
| 19 -<37          | 15-20    |      | 5.5/7.5/0.30      |      |      |                    | 5.5/4.7/0.03 |              |                    |      |      |  |
| 37 -<56          | 20-40    |      | 5.0/7.5/0.30      |      |      |                    |              | 5.0/4.7/0.03 |                    |      |      |  |
| 56 -<75          | 40-60    |      | 5.0/4.7/0.40      |      |      |                    | 5.0/2.3/0.02 |              | 5.0/0.19/0.40/0.02 |      |      |  |
| 75 -<130         | 80-100   |      | 5.0/4.0/0.30      |      |      |                    | 5.0/2.3/0.02 |              | 5.0/0.19/0.40/0.02 |      |      |  |
| 130 -<560        | 125-450  |      | 3.5/4.0/0.20      |      |      | 3.5/2.0/0.02       |              |              | 3.5/0.19/0.40/0.02 |      |      |  |
| 560 -<900        | 500-800  |      | 3.5/6.4/0.20      |      |      | 3.5/0.40/0.67/0.10 |              |              | 3.5/0.19/0.67/0.03 |      |      |  |
| >900             | 900-2000 |      | 3.5/6.4/0.20      |      |      | 3.5/0.40/0.67/0.10 |              |              | 3.5/0.19/0.67/0.03 |      |      |  |
| >2200            | >=2000   |      | 11.4/1.3/9.2/0.54 |      |      | 3.5/0.40/0.67/0.10 |              |              | 3.5/0.19/0.67/0.03 |      |      |  |

 TIER 1 Effective  
 TIER 2 Effective  
 TIER 3 Effective

 TIER 4 Interim Effective  
 TIER 4 Effective

CO/NMHC+NOx/PM (g/kW-hr)  
CO/NMHC/NOx/PM (g/kW-hr)

By the end of 2014, the phase in was complete meaning all stationary nonemergency engines MY2015 or newer are required to be Tier 4-certified to be sold into or operated in the U.S. To meet Tier 4 levels, a diesel engine will typically require at least one form of exhaust aftertreatment.

Advanced engines, such as the KD Series™, are able to reduce the formation of the majority of the pollutants in the cylinder and only leave NOx to be addressed with an aftertreatment device.






primarily focused on providing backup power to a reliable utility grid. However, utilizing a diesel generator in a nonemergency application, such as peak shaving or curtailment, has many financial benefits.

When doing so, there are certain provisions to Tier 4 regulations that a specifying engineer or end customer needs to be aware of.

**Figure 6** Phase-In Program for Stationary Emergency Engines

| ENGINE GENERATOR |          | 2007 | 2008              | 2009 | 2010 | 2011 | 2012         | 2013         | 2014 | 2015 | 2016 |
|------------------|----------|------|-------------------|------|------|------|--------------|--------------|------|------|------|
| kWm              | kWe      |      |                   |      |      |      |              |              |      |      |      |
| 8 -<19           | 10-15    |      |                   |      |      |      | 6.6/7.5/0.40 |              |      |      |      |
| 19 -<37          | 15-20    |      |                   |      |      |      | 5.5/7.5/0.30 |              |      |      |      |
| 37 -<56          | 20-40    |      |                   |      |      |      | 5.0/4.7/0.40 |              |      |      |      |
| 56 -<75          | 40-60    |      |                   |      |      |      | 5.0/4.7/0.40 |              |      |      |      |
| 75 -<130         | 80-100   |      |                   |      |      |      | 5.0/4.0/0.30 |              |      |      |      |
| 130 -<560        | 125-450  |      |                   |      |      |      | 3.5/4.0/0.20 |              |      |      |      |
| 560 -<900        | 500-800  |      |                   |      |      |      | 3.5/6.4/0.20 |              |      |      |      |
| >900             | 900-2000 |      |                   |      |      |      | 3.5/6.4/0.20 |              |      |      |      |
| >2200            | >=2000   |      | 11.4/1.3/9.2/0.54 |      |      |      |              | 3.5/6.4/0.20 |      |      |      |

|                          |   |                  |   |                          |
|--------------------------|---|------------------|---|--------------------------|
| CO/NMHC+NOx/PM (g/kW-hr) |  | TIER 1 Effective |  | TIER 4 Interim Effective |
| CO/NMHC/NOx/PM (g/kW-hr) |  | TIER 2 Effective |  | TIER 4 Effective         |
|                          |  | TIER 3 Effective |   |                          |

**INDUCEMENT**

The aftertreatment system is considered integral to a Tier 4 system. The EPA therefore dictates that a failure of the aftertreatment system constitutes a failure of the entire engine.

Instead of forcing an immediate shutdown, the engine enters inducement. The intent is to “induce” the operator to fix the issue with the aftertreatment system. If the failure is not corrected in the allotted time, the engine power is limited until the issue is fixed. Examples of issues that may lead to inducement include poor DEF quality, sensor failures, or running out of DEF, etc.

**DIESEL EMISSION FLUID (DEF) REFILL INTERVAL**

DEF must not run out before diesel fuel under normal operating conditions. Therefore, sizing of DEF storage must correlate to the amount of diesel fuel storage.

For a stationary generator this can require calculating the size of multiple tanks as day tanks are commonplace, especially for indoor installations.

**CRANKCASE VENTILATION**

Tier 4 engines do not require the use of closed crankcase ventilation (CCV). However, the emissions from open crankcase systems are included in the total emissions of the engine

Therefore, most Tier 4 engines will include a CCV to reduce the overall emissions.

**DIESEL ENGINE EMISSION TEST CYCLES:**

**EMISSIONS VALUES DEFINED**

Emission values are referred to as either meeting a Tier level (nominal values) or a Potential to Emit (PTE) (not to exceed or NTE) level.

The two classifications are both important but relate to two different reported values (nominal and not to exceed).

**NOMINAL VALUES**

According to EPA ISO-8178 Constant Speed D2 5 Mode Cycle, the emissions levels previously referenced throughout this white paper all are values related to the ISO-8178 Constant Speed Test Cycle.

Nominal data is captured in a test cell under controlled conditions (e.g., controlled environment test conditions). The testing is completed by taking a weighted average of the engine emissions at five steady state points.

The five modes weighted and averaged as shown in *Figure 7*. The weighted levels are then used to measure compliance against an EPA standard.

*Figure 7*

| ISO-8173 Constant Speed D2 5 Mode Cycle |             |     |     |     |     |
|---|-------------|-----|-----|-----|-----|
| Mode Number                             | 1           | 2   | 3   | 4   | 5   |
| Speed                                   | Rated Speed |     |     |     |     |
| Torque                                  | 100%        | 75% | 50% | 25% | 10% |
| Weighting                               | 5%          | 25% | 30% | 30% | 10% |

**NOT-TO-EXCEED VALUES**

Not-to-exceed data adds a safety factor to the nominal data for field conditions that cannot be controlled in a lab (e.g., ambient, humidity, production engine tolerances, and field emission test methods).

It is important to work with regional requirements for permitting stationary engines to understand which emissions data (nominal or NTE/PTE) and which engine operating loads are requested for the permit data. If there will be stack testing requirements, the NTE data would be required.

**KOHLER® ADVANTAGES:****KD SERIES™ EMISSION TECHNOLOGY**

Kohler Power Systems has 100 years of experience in industrial on-site power generation. Our industry experts are constantly monitoring and adjusting to new regulations.

You can be assured that a KOHLER generator set is powered by an engine compliant with all applicable federal U.S. EPA exhaust emissions regulations. Utilizing this expertise, KOHLER KD Series engines were developed to offer industry leading emissions technology, making them a top choice for all market segments including data centers, healthcare, and water/waste-water treatment.

The engines were developed from the ground up, utilizing the latest in-cylinder emission reduction technologies. The KD Series engines were developed with Tier 4 emission levels in mind. The forethought gave way to a simple system, requiring only a selective catalytic reduction aftertreatment device. In addition, the 2000 KW and larger KD Series emergency standby (Tier 2 emissions) generators also have low NOx calibrations that can be utilized to avoid using aftertreatment equipment in many non-attainment areas with NOx concerns.

**SUMMARY:**

Understanding emission requirements is an important step to ensure the correct generator set is selected for an application.

This white paper covered federal emission standards for diesel engines powering generator sets in the U.S. In addition to these regulations, local or regional regulations that enforce limits more stringent than the federal standards may exist.

It remains the responsibility of the specifying engineer to understand both the federal and the local requirements.

A local Kohler representative is ready and willing help with questions and provide explanations. Each Kohler representative works with both federal and local regulations on a regular basis and is backed up by Kohler's factory emissions experts.

**ADDITIONAL RESOURCES:****INTERNET LINKS**

1. EPA Emissions Standards: <https://www.epa.gov/emission-standards-reference-guide/epa-emission-standards-nonroad-engines-and-vehicles>
2. Electronic Code of Federal Regulations (eCFR) home: <https://www.ecfr.gov/cgi-bin/ECFR?page=browse>
3. CARB California Air Resources Board (CARB) Emergency Backup Generators <https://ww2.arb.ca.gov/our-work/programs/emergency-backup-generators>
4. South Coast AQMD Emergency Generator Fact Sheet: [www.aqmd.gov/home/permits/emergency-generators](http://www.aqmd.gov/home/permits/emergency-generators)



## ABOUT THE AUTHOR

**Brad Meissner** currently works as a Product Manager with responsibility for >700 KW diesel generators at Kohler Co.

Degreed in both mechanical engineering and engineering management, he has spent more than seven years in the power generation industry. His career started in engineering developing alternators, diesel fuel tanks, enclosures, and generator sets. For the last three years, he has worked as part of the product management team at Kohler Co. His specialties include codes and standards, diesel emissions, generator set packaging, and mechanical systems.

A global force in power solutions since 1920, Kohler Co. is committed to reliable, intelligent products; purposeful engineering; and responsive after-sales support. Kohler Co. is among the world's largest manufacturers of industrial generators. The company has 100 years' experience in industrial power and benefit from global R&D, manufacturing, sales, service, and distribution integration.

**KOHLER**  
IN POWER. SINCE 1920.

**KOHLER POWER.COM**

Printed in U.S.A. G26-35 KPS 124 11/20 © 2020 by Kohler Co.